
1

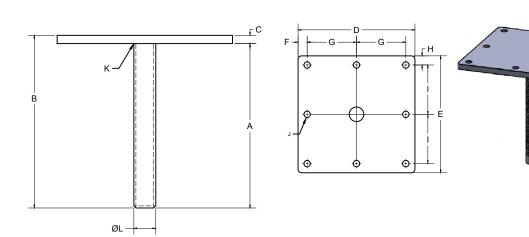

NOTES:

1-MATERIALS:

-PLATE PER CSA G40.21 50W, MIN.FY=60 KSI, FU=70KSI -F3125 GRADE A325 OR ASTM A449 TYPE 1 WITH MIN.YIELD STRENGHT OF 92 KSI AND MIN.TENSILE STRENGHT OF 120 KSI.

2-ANY CHANGE OF MATERIAL IS SUBJECT TO GOLIATHTECH APPROVAL 3-WELD PERFORMED IN ACCORDANCE WITH CSA STANDARD W47.1 AND GOLIATHTECH WELDING PROCEDURES. WELDERS ARE ALSO

CERTIFIED TO THE AWS STANDARD. 4-HOT-DIP GALVANIZED, PARTS PER ASTM A153.

	3		
	2		
	1	INITIAL RELEASE	2023-05-25
	REV	MODIFICATION	DATE

REVISION

GOLIFTHIECH

TITLE: Flat 8x8" Plate 3/8 inch thick on 1" Threaded Rod

EAL:	DWG. NO :
	GTBRODPL8
	DRAWN BY:
	R.E
	DESIGN BY:
	GOLIATHTECH
	CHECK BY:
	CPOC
	APP BY:
	СРОС
	OTHER NO:

FORMAT : A		REV.:		DATE:		PAGE :		
		NTS	1	L		2023-05-25		DΕ

GTBASE238-8X8-C

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION AND MAY NOT BE REPRODUCED OR COPIED WITHOUT THE EXPRESS WRITTEN PERMISSION OF A DULY AUTHORIZED REPRESENTATIVE OF GOLIATHTECH INC.

	Dimension (inches)	Description	MECHANICAL ASD LOAD CAPACITY					
			Compress	ion (kips)	Tension (kips)	Lateral (kips)		
NO.			Description				ree ^a	
Α	7 1/2		0	33.40				
В	7 7/8		0.5	30.98				
С	3/8		1	29.70				
D	8		2	27.36				
Ε	8		3	25.28	6.38	9.65		
F	5/8		4	23.41				
G	3 3/8		5	21.72				
Н	5/8		6	20.20				
I	7/16		Max	18.97				
J	3 3/8			1. The ASD capacities are based on limit states associated with mechanical steel strength of the bracket to the helical pile shaft.				
K	1/4	Weld	Steel column, shaft, or geotechnical capacities may control. The member supported by the bracket must be designed by the registered design professional and must not exceed the tabulated capacities. The supported member must be connected to					
L	1 - 8 UNC		bracket plate with a minimum of four bolts ASTM A325 and must have a minimum thickness of at least 1.5 times the plate thickness.					

3. Tabulated capacities based on four (4) - ½ - inch diameter hex head bolts

Section 3.9 of AC358 for a 50-year service life.

2.The tabulated capacities assume the pile foundation system is sidesway braced per IBC Section 18.10.2.2

6.Adjustable brackets are to be used with corresponding GTBASEXXX, see GTBASEXXX drawings for details.

plate and its column, are to be determined by the design professional on a job specific basis.

4.Threaded rod length is the distance above the top of the adjustable connection head. Maximum threaded rod length is 6.507 inch.5.All components above the bracket, including the interaction between the base plate and the bolts, and the weld between base

6.Capacities for galvanized steel brackets are based on galvanized steel losing 0.013-inch (330μm) steel thickness as indicated in

2